


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

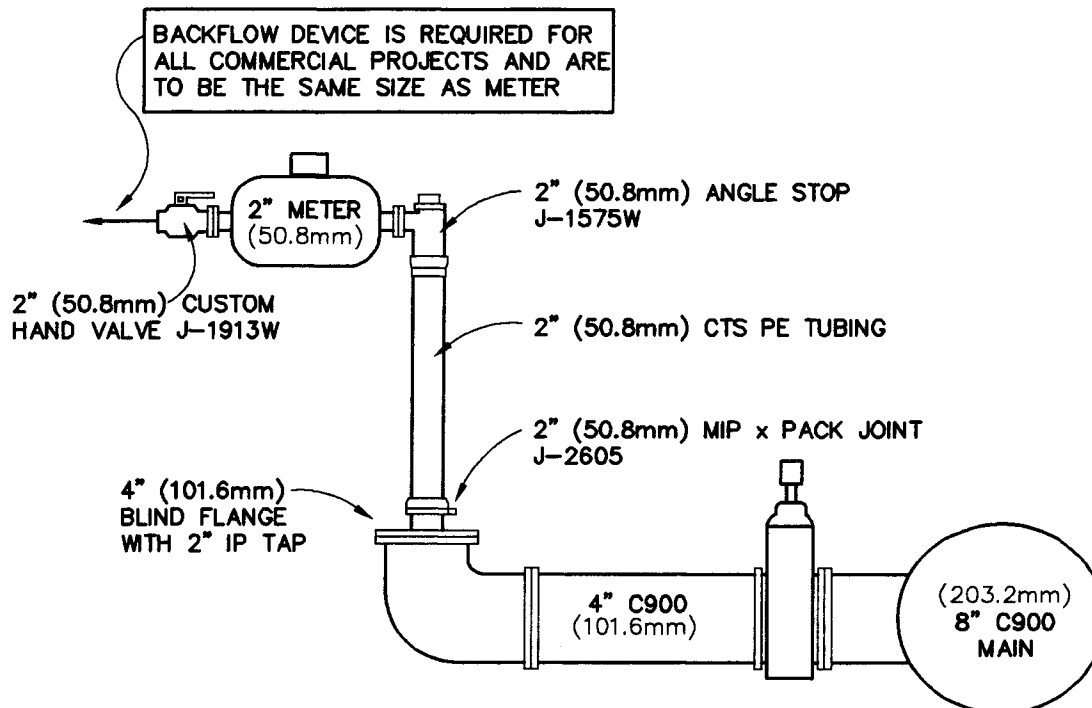

1. ALL PACK JOINT CONNECTIONS ALSO REQUIRE STAINLESS STEEL INSERTS.
2. PART NUMBERS CALLED ARE JAMES JONES COMPANY AND MAYBE SUBSTITUTED AT THE APPROVAL OF THE CITY ENGINEER.
3. THIS DETAIL IS TYPICALLY USED FOR A COMMERCIAL PROJECT.

DRAWN BY: C.A.C.	CITY OF PASO ROBLES ENGINEERING DIVISION	DRAWING NO.
DESIGNED BY:		
DATE: 4/18/94	4" (101.6mm) WATER SERVICE ASSEMBLY TO 2-INCH METER	G-8
FILE NAME: PR-G-8.DWG		